


VERTICAL TURBINE ELECTRIC DRIVEN | TYPICAL FIRE PUMP INSTALLATION

File No: F51.168
Date: APRIL 10, 2025
Supersedes: F51.168
Date: AUGUST 15, 2005

Typical fire pump installation with an Armstrong Vertical Turbine can fire pump electric motor driven

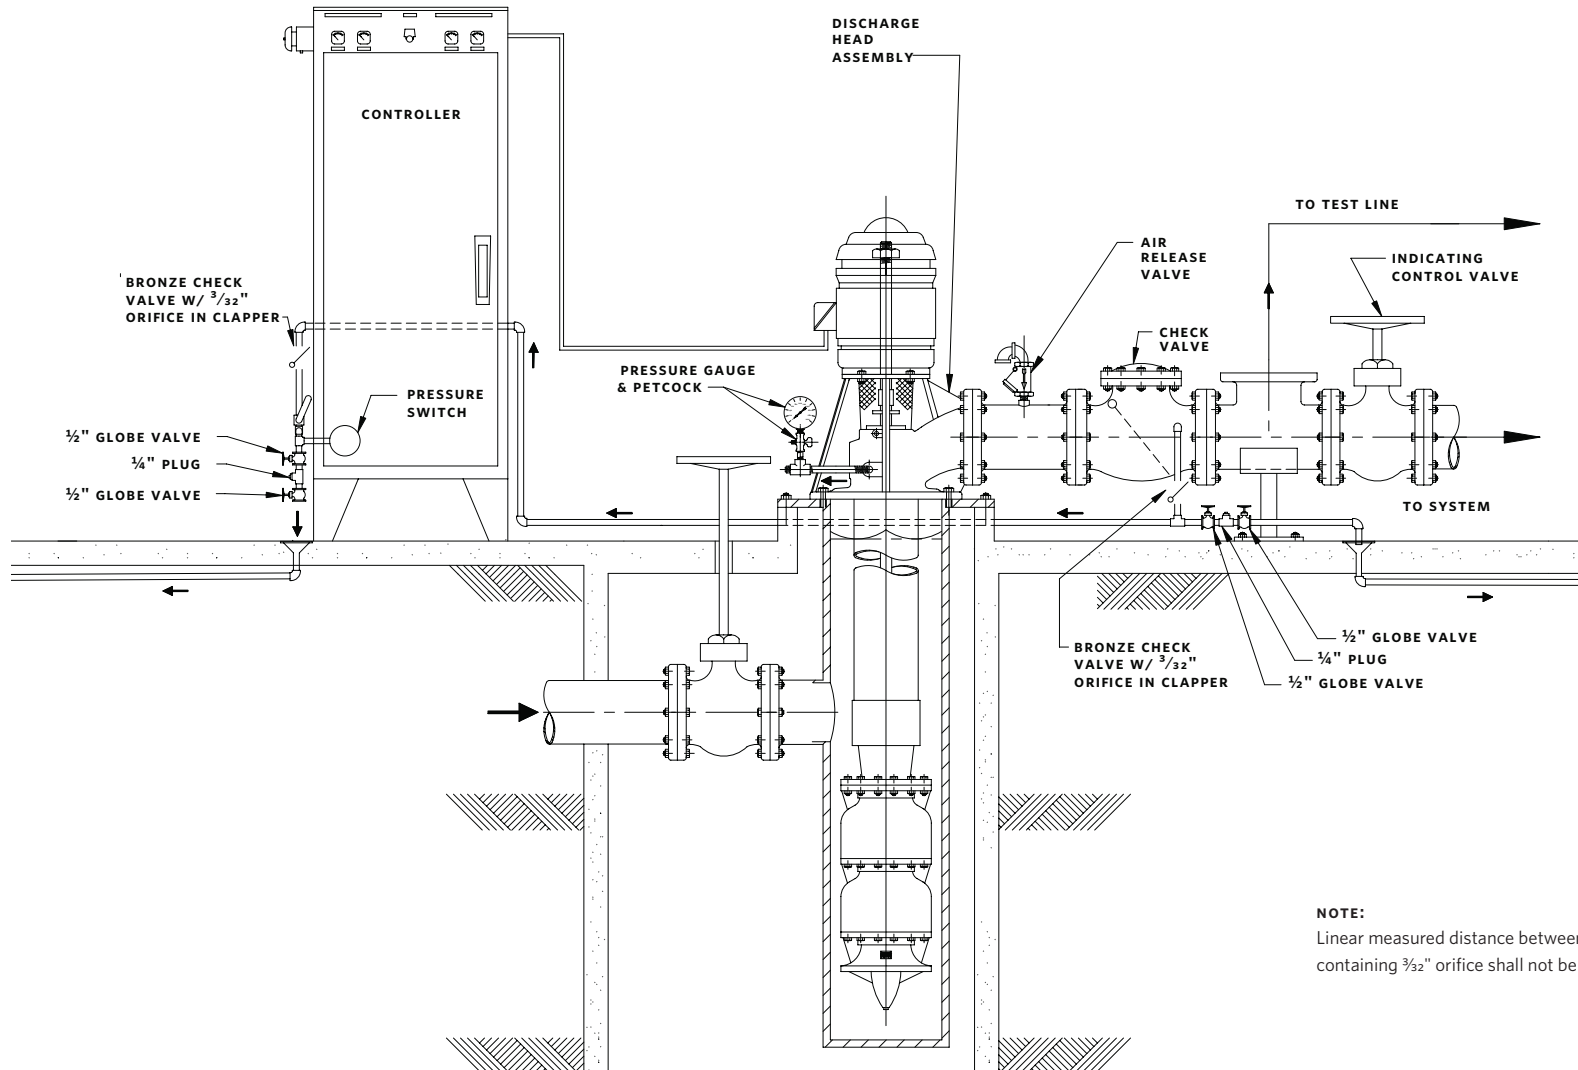

NOTE:
Linear measured distance between the two check valves containing $\frac{3}{32}$ " orifice shall not be less than 5' - 0" per NFPA20.