


VERTICAL TURBINE ACCESSORIES | TYPICAL FIRE PUMP INSTALLATION

File No: F51.170
 Date: APRIL 10, 2025
 Supersedes: F51.170
 Date: AUGUST 15, 2005

Typical Accessories System layout

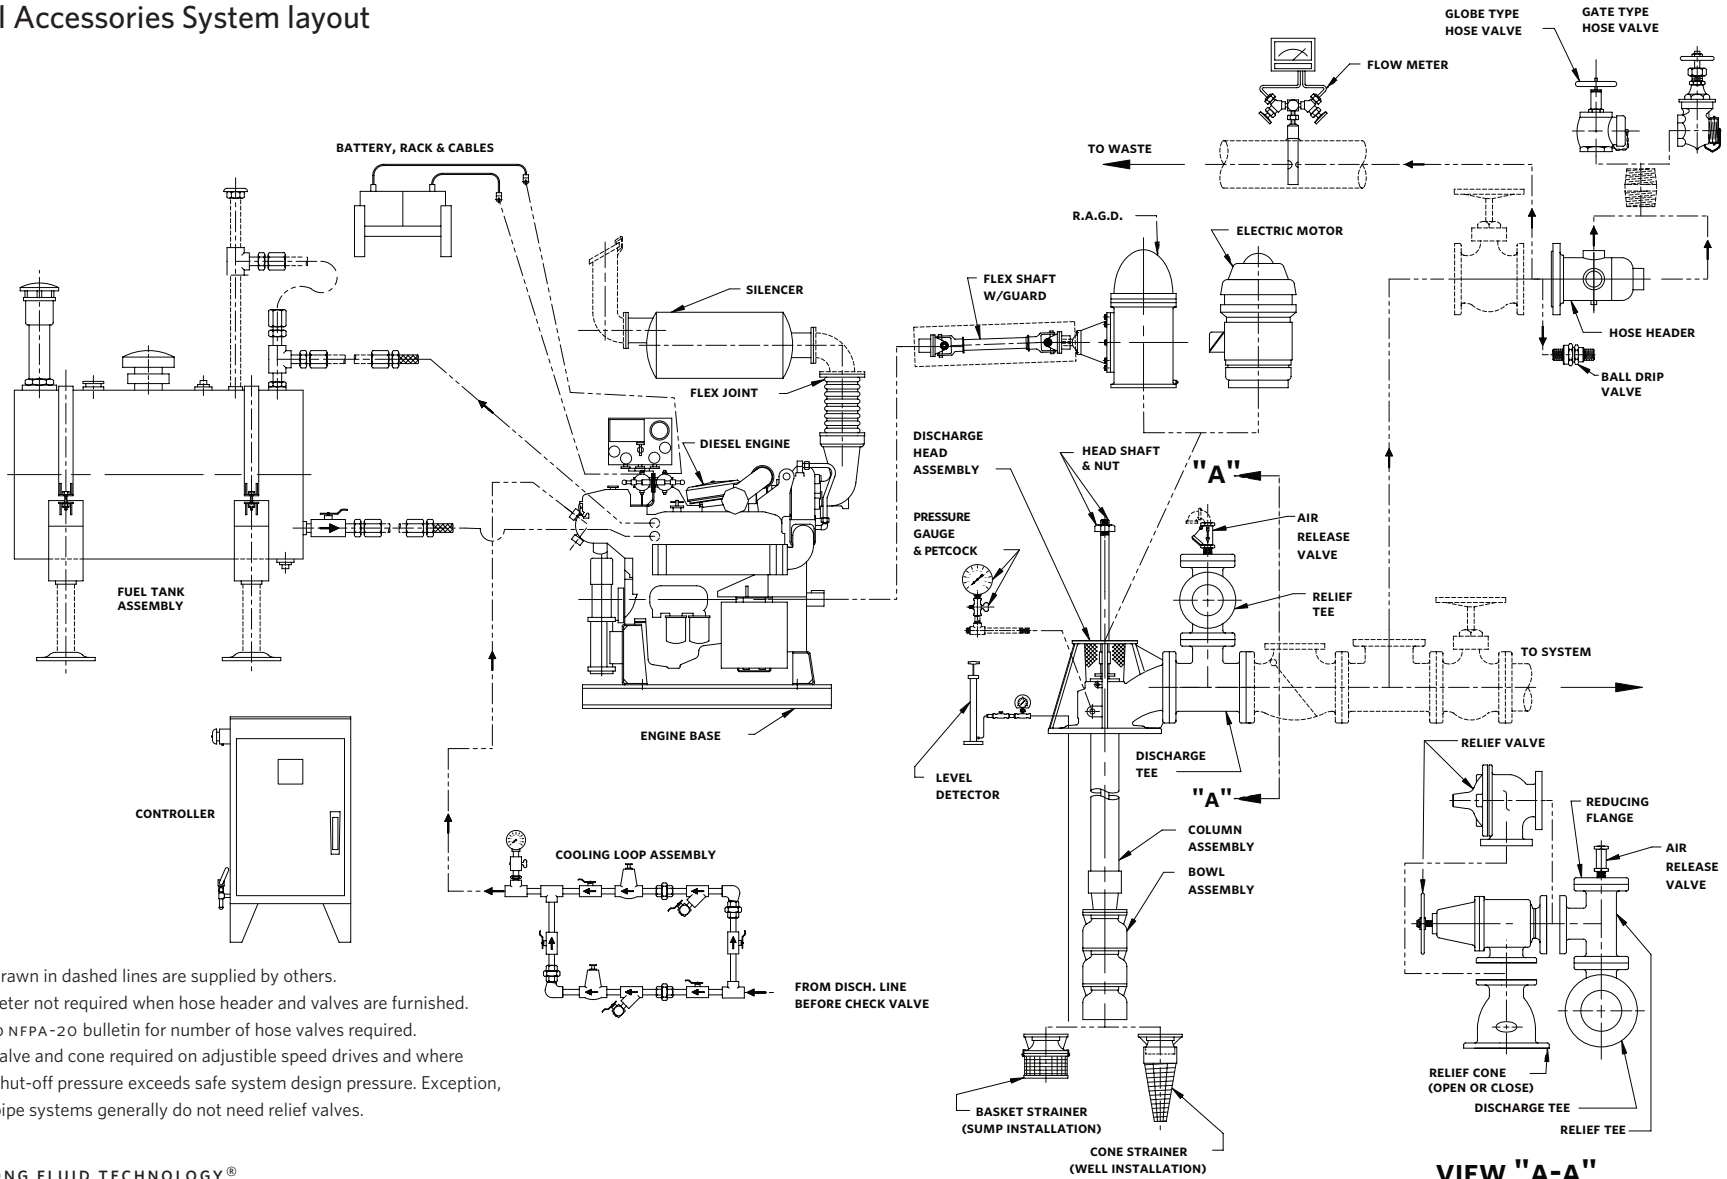

NOTE:

1. Items drawn in dashed lines are supplied by others.
2. Flow meter not required when hose header and valves are furnished.
3. Refer to NFPA-20 bulletin for number of hose valves required.
4. Relief valve and cone required on adjustable speed drives and where Pump shut-off pressure exceeds safe system design pressure. Exception, Stand pipe systems generally do not need relief valves.