

DESIGN ENVELOPE 4200H END SUCTION

File No: 103.5199 Date: AUGUST 1, 2018 Supersedes: 103.5199 Date: MARCH 30, 2018

0813-030.0 SUBMITTAL

Job:	Representative:	
	Order No:	_Date:
Engineer:		_Date:
Contractor:	Approved by:	Date:

PUMP DESIGN DATA CONTROLS DATA No. of pumps: ____ _____ Tag: _____ Protocol (standard): □ BACnet[™] MS/TP Capacity: _____USgpm (L/s) Head: _____ft (m) □ BACnet[™] TCP/IP □ Modbus rtu Liquid: _____ Viscosity: _____ Temperature: ______°F (°C) Specific gravity: ____ Enclosure: Indoor - UL TYPE 12 Fused disconnect switch: Suction: 10"(250mm) Flanged EMI/RFI control: Integrated filter designed to meet Discharge: 8"(200mm) Flanged en61800-3 UL STD 778 & CSA STD C22.2 NO.108 certified Harmonic suppression: Dual DC-link reactors (Equivalent: 5% Ac line reactor) Supporting IEEE Test report is supplied with each pump 519-1992 requirements** MOTOR DESIGN DATA **Cooling:** Fan-cooled through back channel HP: 30 RPM: 3600 Frame size: 326TC Enclosure: TEFC Ambient temperature: -10°c to +45°c up to 1000 meters above sea level (+14°F to +113°F, 3300 ft) Volts: _____ Hertz: 60 Hz Phase: 3 Analog I/o: Two current or voltage inputs, Efficiency: NEMA premium 12.12 one speed output Digital I/O: Two inputs, two outputs Pulse inputs: Two programmable MAXIMUM PUMP OPERATING CONDITIONS Relay outputs: Two programmable ANSI 125 - (CONSTRUCTION: BF)

175 psig at 150°F (12 bar at 65°C) 100 psig at 300°F (7 bar at 150°C)

ANSI 250 - (CONSTRUCTION: DBF)

375 psig at 150°F (26 bar at 65°C) 260 psig at 300°F (21 bar at 150°C)

FLOW READOUT ACCURACY

The Design Envelope model selected will provide flow reading on the controls local keypad & digitally for the BMS. The model readout will be factory tested to ensure $\pm 5\%$ accuracy.

** The IVS drive is a low harmonic drive via built-in DC line reactors. This does not guaranty performance to any system wide harmonic specification or the costs to meet a system wide specification. If supplied with the system electrical details, Armstrong will run a computer simulation of the system wide harmonics. If system harmonic levels are exceeded Armstrong can also recommend additional harmonic mitigation and the costs for such mitigation.

MECHANICAL SEAL DATA

Communication port: 1-RS485

Seal type: AB2 Secondary seal: Viton Spring: Stainless steel

Stationary seat: Sintered silicon carbide Rotating hardware: Stainless steel

2

OPTIONS

SENSORLESS BUNDLE (STANDARD)



Operation of pump without a remote sensor. Includes:

- Sensorless control
- Flow readout
- Constant flow
- Constant pressure

Minimum system pressure to be maintained

ft (m)

* If minimum maintained system pressure is not known: Default to 40% of design head

PARALLEL SENSORLESS



Operation of multiple pumps without a remote sensor

Minimum system pressure to be maintained ft (m)

* If minimum maintained system pressure is not known: Default to 40% of design head

П **ENERGY PERFORMANCE BUNDLE**



Provides energy savings on oversized systems by adjusting pump parameters to on-site conditions. Includes:

- Auto-flow balancing Automatically determines control curve between design flow at on-site system head, and minimum (zerohead) flow for energy savings
- Maximum flow control Limits flow rate to pre-set maximum for potential energy savings

Maximum flow rate gpm (L/s)

*Only available if sensorless bundle is enabled

PROTECTION BUNDLE



Protects other flow sensitive equipment by setting limits of pump operation. Includes:

- · Minimum flow control Attempts to maintain flow rate to pre-set minimum to protect equipment in system
- Bypass valve control Actuates a bypass valve to protect flow sensitive equipment if pre-set minimum flow rate is reached

Minimum flow rate qpm(L/s)

pumps in 2-pipe systems

Cooling

DUAL SEASON SETUP

ZONE OPTIMIZATION BUNDLE


satisfied for heating or cooling

satisfied for heating or cooling

Controls pumps to ensure multiple zones are

• 2 sensor control - Controls pumps in a 2-zone

application to ensure both zones are always



Pre-sets heating and cooling parameters for

Duty point	gpm (L/s) at	ft (m)	
Minimum system pressure to be maintained			
ft	(m)		

OPTIONAL SERVICES

ON-SITE PUMP COMMISSIONING



Where purchased and applicable, onsite commissioning by an Armstrong representative will include setting up communication with the Pump (not wiring to BAS), adjusting parameters to match on-site conditions, register the pumps for enhanced warranty and connect the pumps to the router as part of the activation of Pump Manager.

PUMP MANAGER



As a Performance Management Service, Pump Manager is an online automated fault detection and diagnostic service for sustained performance and enhanced reliability. It includes advanced trending, alerts of variance in performance and automated reports.

Available in yearly increments. Includes an option for a price discount on the Extended Warranty Service.

*The Service requires an active internet connection.

*Only available if sensorless bundle is enabled



п




Heating

Design Envelope 4200H End suction


3

EXTENDED SPEED

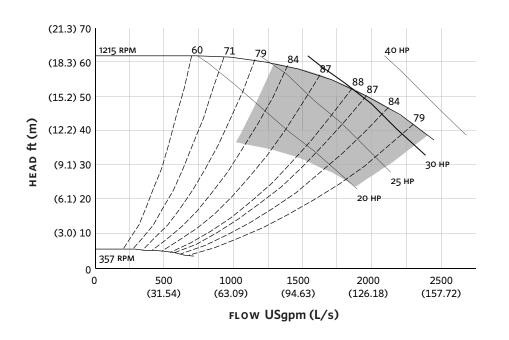

Performance curves are for reference only. Confirm current performance data with Armstrong ACE Online selection software.

INDOOR

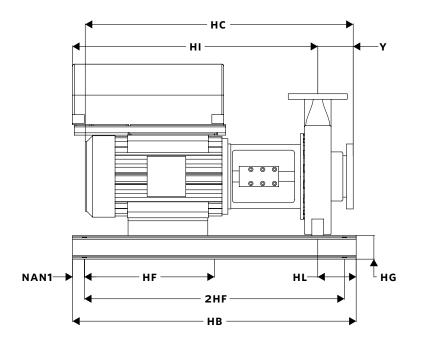


DIMENSION DATA

INDOOR		
	(UL TYPE 12/ODP)	
Frame size:	326TC	
Size:	10×8×13	
HP:	30	
RPM:	1200	
HA:	24.94 (633)	
HB:	66.00 (1676)	
HC:	48.26 (1226)	
HD:	18.50 (470)	
HE:	11.84 (301)	
HF:	31.00 (787)	
2HF:	62.00 (1575)	
HG:	4.00 (102)	
HI:	39.87 (1013)	
HL:	6.50 (165)	
HV:	19.42 (493)	
NaN1:	2.00 (51)	
NaN2:	13.00 (330)	
х:	18.00 (457)	
Y:	6.00 (152)	
Weight:	1377 (624.8)	

Dimensions – inch (mm) Weight – Ibs (kg)

:

- Tolerance of ±0.125" (±3 mm) should be used
- For exact installation, data please write factory for certified dimensions



TORONTO

23 BERTRAND AVENUE TORONTO, ONTARIO CANADA M1L 2P3 +1 416 755 2291

BUFFALO

93 EAST AVENUE NORTH TONAWANDA, NEW YORK U.S.A. 14120-6594 +1 716 693 8813

BIRMINGHAM

HEYWOOD WHARF, MUCKLOW HILL HALESOWEN, WEST MIDLANDS UNITED KINGDOM B62 8DJ +44 (0) 8444 145 145

MANCHESTER

wolverton street manchester united kingdom m11 2et +44 (0) 8444 145 145

BANGALORE

#59, FIRST FLOOR, 3RD MAIN MARGOSA ROAD, MALLESWARAM BANGALORE, INDIA 560 003 +91 (0) 80 4906 3555

SHANGHAI

unit 903, 888 north sichuan rd. hongkou district, shanghai china 200085 +86 (0) 21 5237 0909

SÃO PAULO

RUA JOSÉ SEMIÃO RODRIGUES AGOSTINHO, 1370 GALPÃO 6 EMBU DAS ARTES SAO PAULO, BRAZIL +55 11 4785 1330

ARMSTRONG FLUID TECHNOLOGY ESTABLISHED 1934

ARMSTRONGFLUIDTECHNOLOGY.COM

ENERGA SENSE SENSE