| | |
|---|---|
| **FILE NO.:** | 100.623 |
| **DATE:** | JUNE 14, 2018 |
| **SUPERSEDES:** | 100.623 |
| **DATE:** | MAY 28, 2018 |

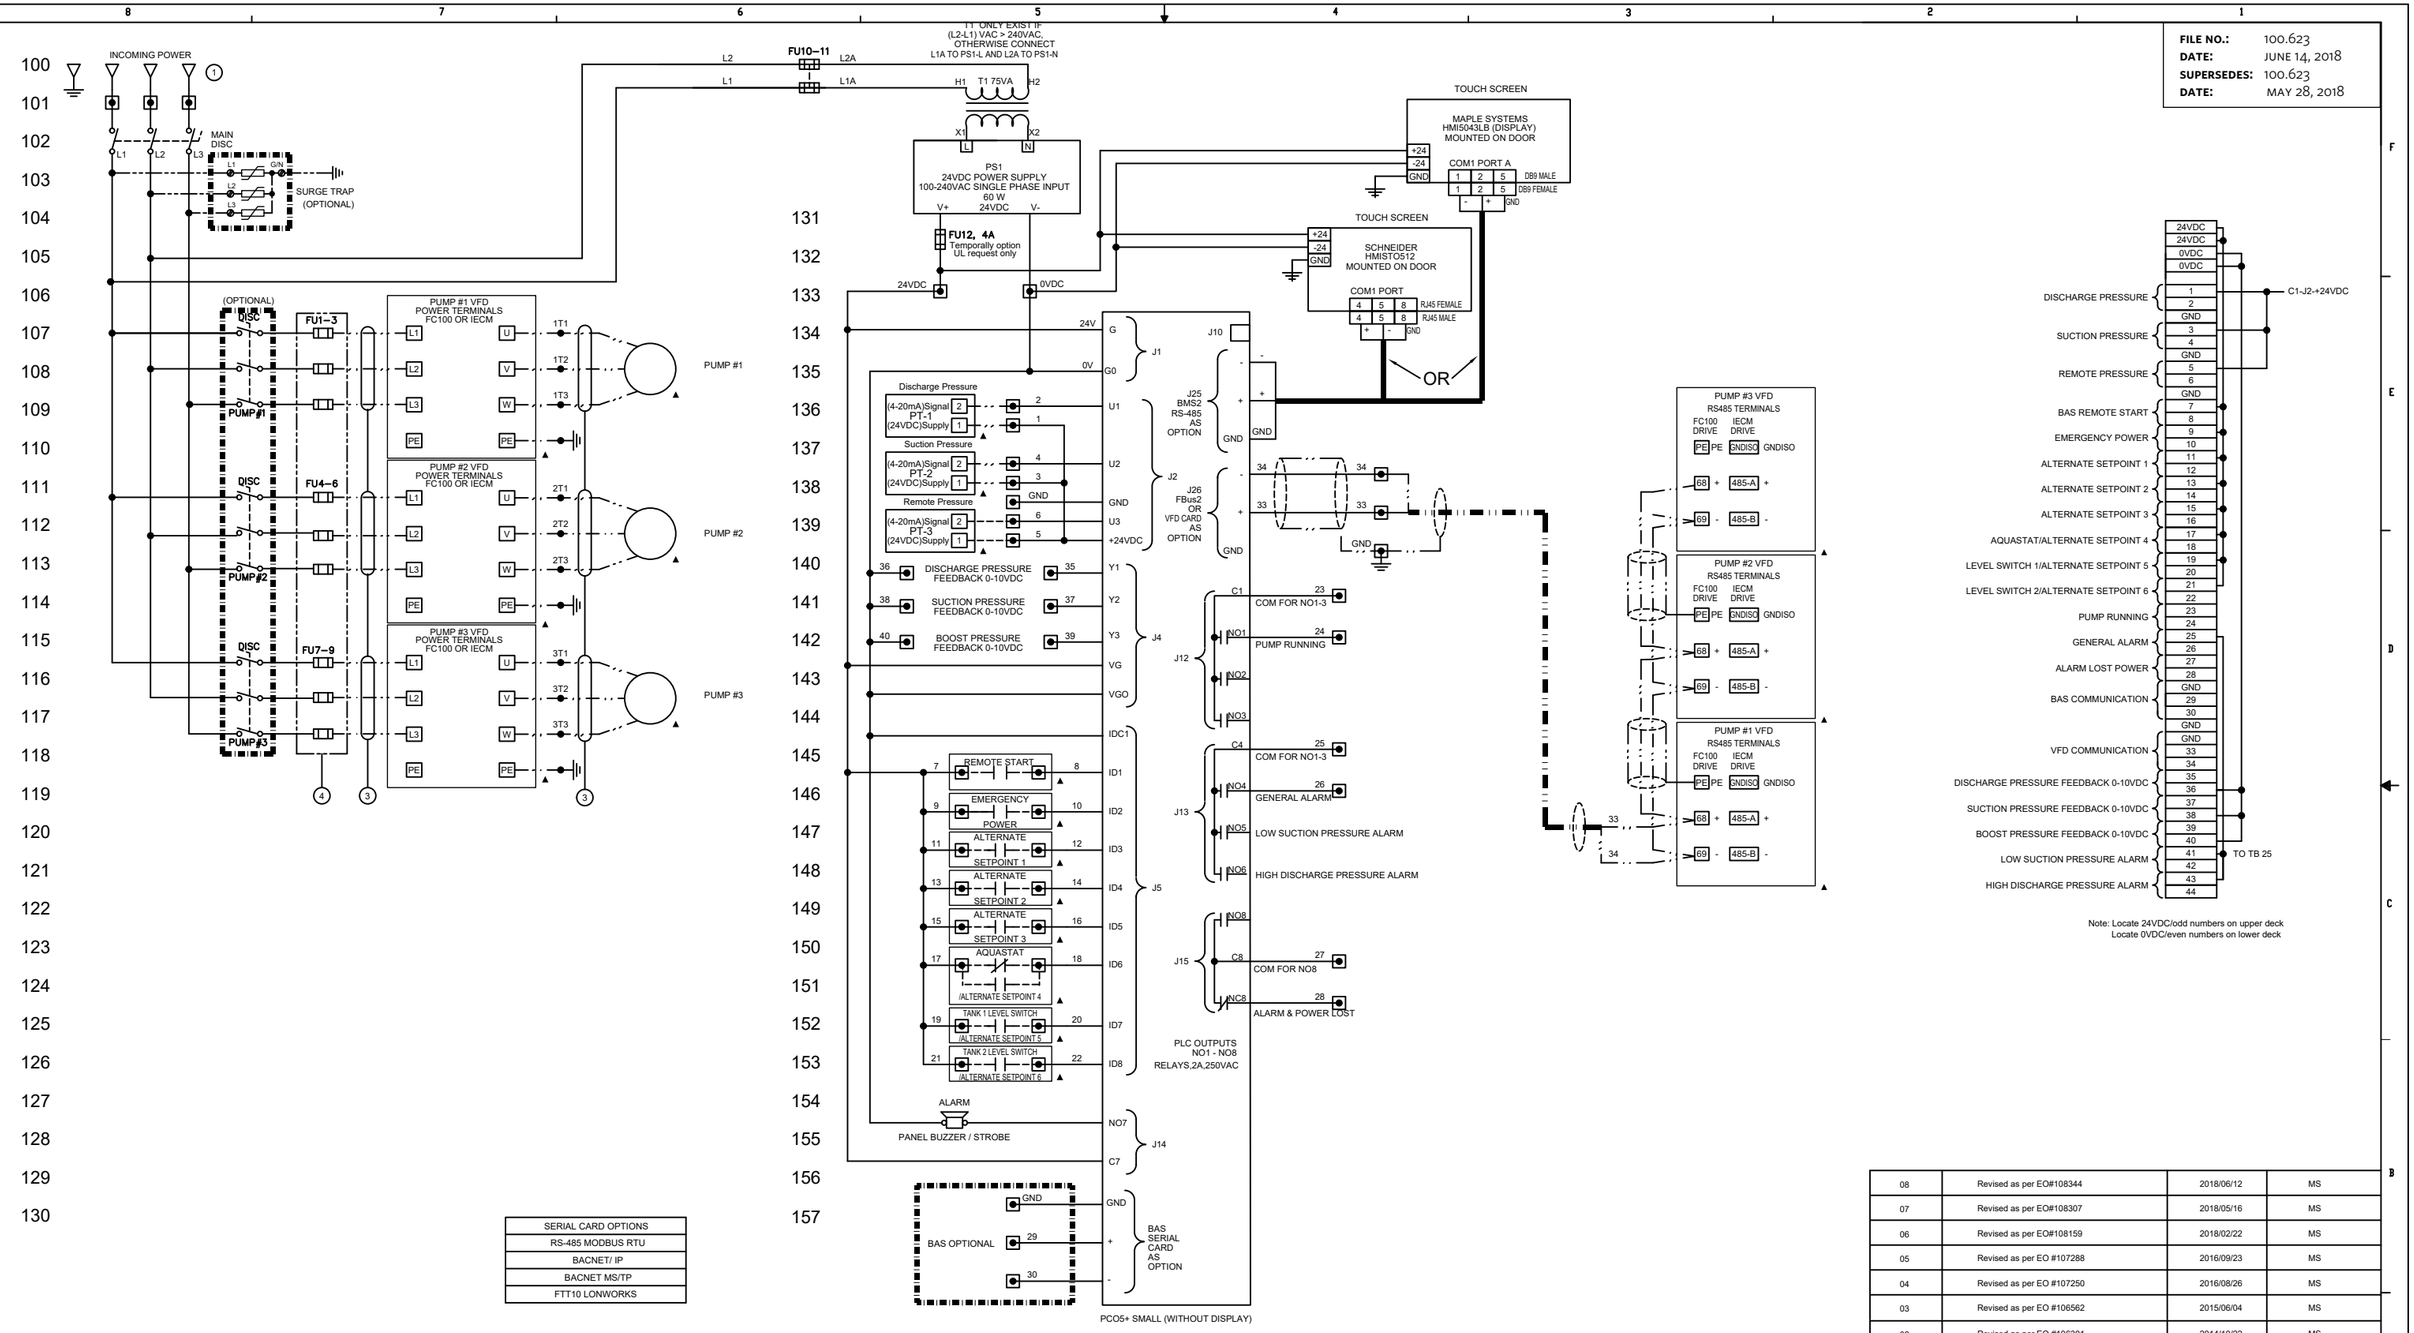


Note: Locate 24VDC/odd numbers on upper deck
Locate 0VDC/even numbers on lower deck

| SERIAL CARD OPTIONS |
|---|
| RS-485 MODBUS RTU |
| BACNET/ IP |
| BACNET MS/TP |
| FTT10 LONWORKS |

## NOTES:

- ■ - TERMINAL POINT
- ▲ - REMOTE DEVICE (BY OTHERS)
- – – – – – – – - WIRING (BY OTHERS)
- —— · · —— - WIRING (BY ARMSTRONG)
- ———— - WIRING (BY PANEL MANUFACTURER)

1. - CUSTOMER MUST PROVIDE BRANCH-CIRCUIT PROTECTION.
2. - ALL PANELS TO BE MANUFACTURED AND LABELED IN ACCORDANCE WITH UL/cUL508 AND OPTIONAL CSA .
3. - FOR PANEL WIRE AND CONDUIT SIZES, REFER TO AES2011010
4. MUST USE FUSE SIZE & TYPE RECOMMENDED BY DRIVE MANUFACTURER

| | | | |
|---|---|---|---|
| 08 | Revised as per EO#108344 | 2018/06/12 | MS |
| 07 | Revised as per EO#108307 | 2018/05/16 | MS |
| 06 | Revised as per EO#108159 | 2018/02/22 | MS |
| 05 | Revised as per EO #107288 | 2016/09/23 | MS |
| 04 | Revised as per EO #107250 | 2016/08/26 | MS |
| 03 | Revised as per EO #106562 | 2015/06/04 | MS |
| 02 | Revised as per EO #106301 | 2014/10/22 | MS |
| 01 | Revised as per EO #106047 | 2014/03/12 | JJK |
| ORG | Released as per ECO 105951 | 2013/ 12/12 | JJK |

| | NAME | DATE |
|---|---|---|
| DRAWN | JJK | 2014/03/12 |
| CHECKED | CAP | 2014/03/12 |
| Q.A. | | 2014/03/12 |
| MFG APPR. | | 2014/03/12 |
| ENG APPR. | JJK | 2014/03/12 |
| CUSTOMER: | | |
| JOB NO: | | |

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF ARMSTRONG PUMPS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF ARMSTRONG PUMPS, INC. IS PROHIBITED.

DESIGN AUTHORITY: ARMSTRONG PUMPS, INC.

ARMSTRONG

TITLE:
# IVS 3 Pump Booster
## Wiring Diagram

| SIZE | DWG. NO. | REV |
|---|---|---|
| D | PTPIVS03M0-801 | 08 |

SCALE: NONE WEIGHT: SHEET 01 of 01